


<b>257.83 (b) (2)</b>	<b>REPORT OF ANNUAL INSPECTION OF CCR SURFACE IMPOUNDMENT</b>		
	<b>FACILITY NAME:</b> Plant Wansley Ash Pond		
	<b>OWNER/OPERATOR OF FACILITY:</b> Georgia Power Company		
	<b>INSPECTION DATE:</b> August 17, 2015		
	<b>INSPECTING ENGINEER:</b> Todd L. Barber, PE (GA Reg. # PE025787)		
	Based on the results of my inspection and review of the data provided, it is my professional opinion that the report has been completed in accordance with 40 CFR 257.83(b).		
<b>(i)</b>	<b>ANY CHANGES IN GEOMETRY OF THE IMPOUNDING STRUCTURE SINCE THE PREVIOUS ANNUAL INSPECTION?</b>	<b>N/A*</b>	
	(IF YES, DESCRIBE):		
<b>(ii)</b>	<b>LOCATION AND TYPE OF EXISTING INSTRUMENTATION</b>	<b>SEE ATTACHED PLAN</b>	
<b>(ii)</b>	<b>MAXIMUM RECORDED READING OF EACH INSTRUMENT SINCE PREVIOUS ANNUAL INSPECTION</b>	<b>N/A*</b>	
	<b>APPROXIMATE MINIMUM, MAXIMUM AND PRESENT DEPTH AND ELEVATION OF THE IMPOUNDED WATER SINCE PREVIOUS ANNUAL INSPECTION</b>		
	MIN. DEPTH: N/A*	MAX. DEPTH: N/A*	PRESENT DEPTH: Up to 65'
	MIN. ELEVATION: N/A*	MAX. ELEVATION: N/A*	PRESENT ELEVATION: 795.6'
<b>(iii)</b>	<b>APPROXIMATE MINIMUM, MAXIMUM AND PRESENT DEPTH AND ELEVATION OF CCR SINCE PREVIOUS ANNUAL INSPECTION.</b>		
	MIN. DEPTH: N/A*	MAX. DEPTH: N/A*	PRESENT DEPTH: Up to 98'
	MIN. ELEVATION: N/A*	MAX. ELEVATION: N/A*	PRESENT ELEVATION: 796.6'
<b>(iv)</b>	<b>APPROXIMATE STORAGE CAPACITY OF IMPOUNDING STRUCTURE AT TIME OF INSPECTION (yd<sup>3</sup>)</b>	24,603,333**	
<b>(v)</b>	<b>APPROXIMATE VOLUME OF IMPOUNDED WATER AND CCR AT TIME OF INSPECTION (yd<sup>3</sup>)</b>	<b>WATER:</b> 10,487,320**	<b>CCR:</b> 14,116,013**
<b>(vi)</b>	<b>ANY APPEARANCE OF AN ACTUAL OR POTENTIAL STRUCTURAL WEAKNESS OF THE CCR UNIT, IN ADDITION TO ANY EXISTING CONDITIONS THAT ARE DISRUPTING OR HAVE THE POTENTIAL TO DISRUPT THE OPERATION AND SAFETY OF THE CCR UNIT AND APPURTENANT STRUCTURES?</b>	<b>NO</b>	
	(IF YES, DESCRIBE):		
<b>(vii)</b>	<b>ANY OTHER CHANGE(S) WHICH MAY HAVE AFFECTED THE STABILITY OR OPERATION SINCE THE PREVIOUS ANNUAL INSPECTION?</b>	<b>N/A*</b>	
	(IF YES, DESCRIBE):		

\* This is the first 'Annual inspection by a qualified professional engineer' performed in accordance with 40 CFR Part 257.83. This information will be included in subsequent annual inspection reports.

\*\* Cubic yard estimates derived by qualified personnel from available information.



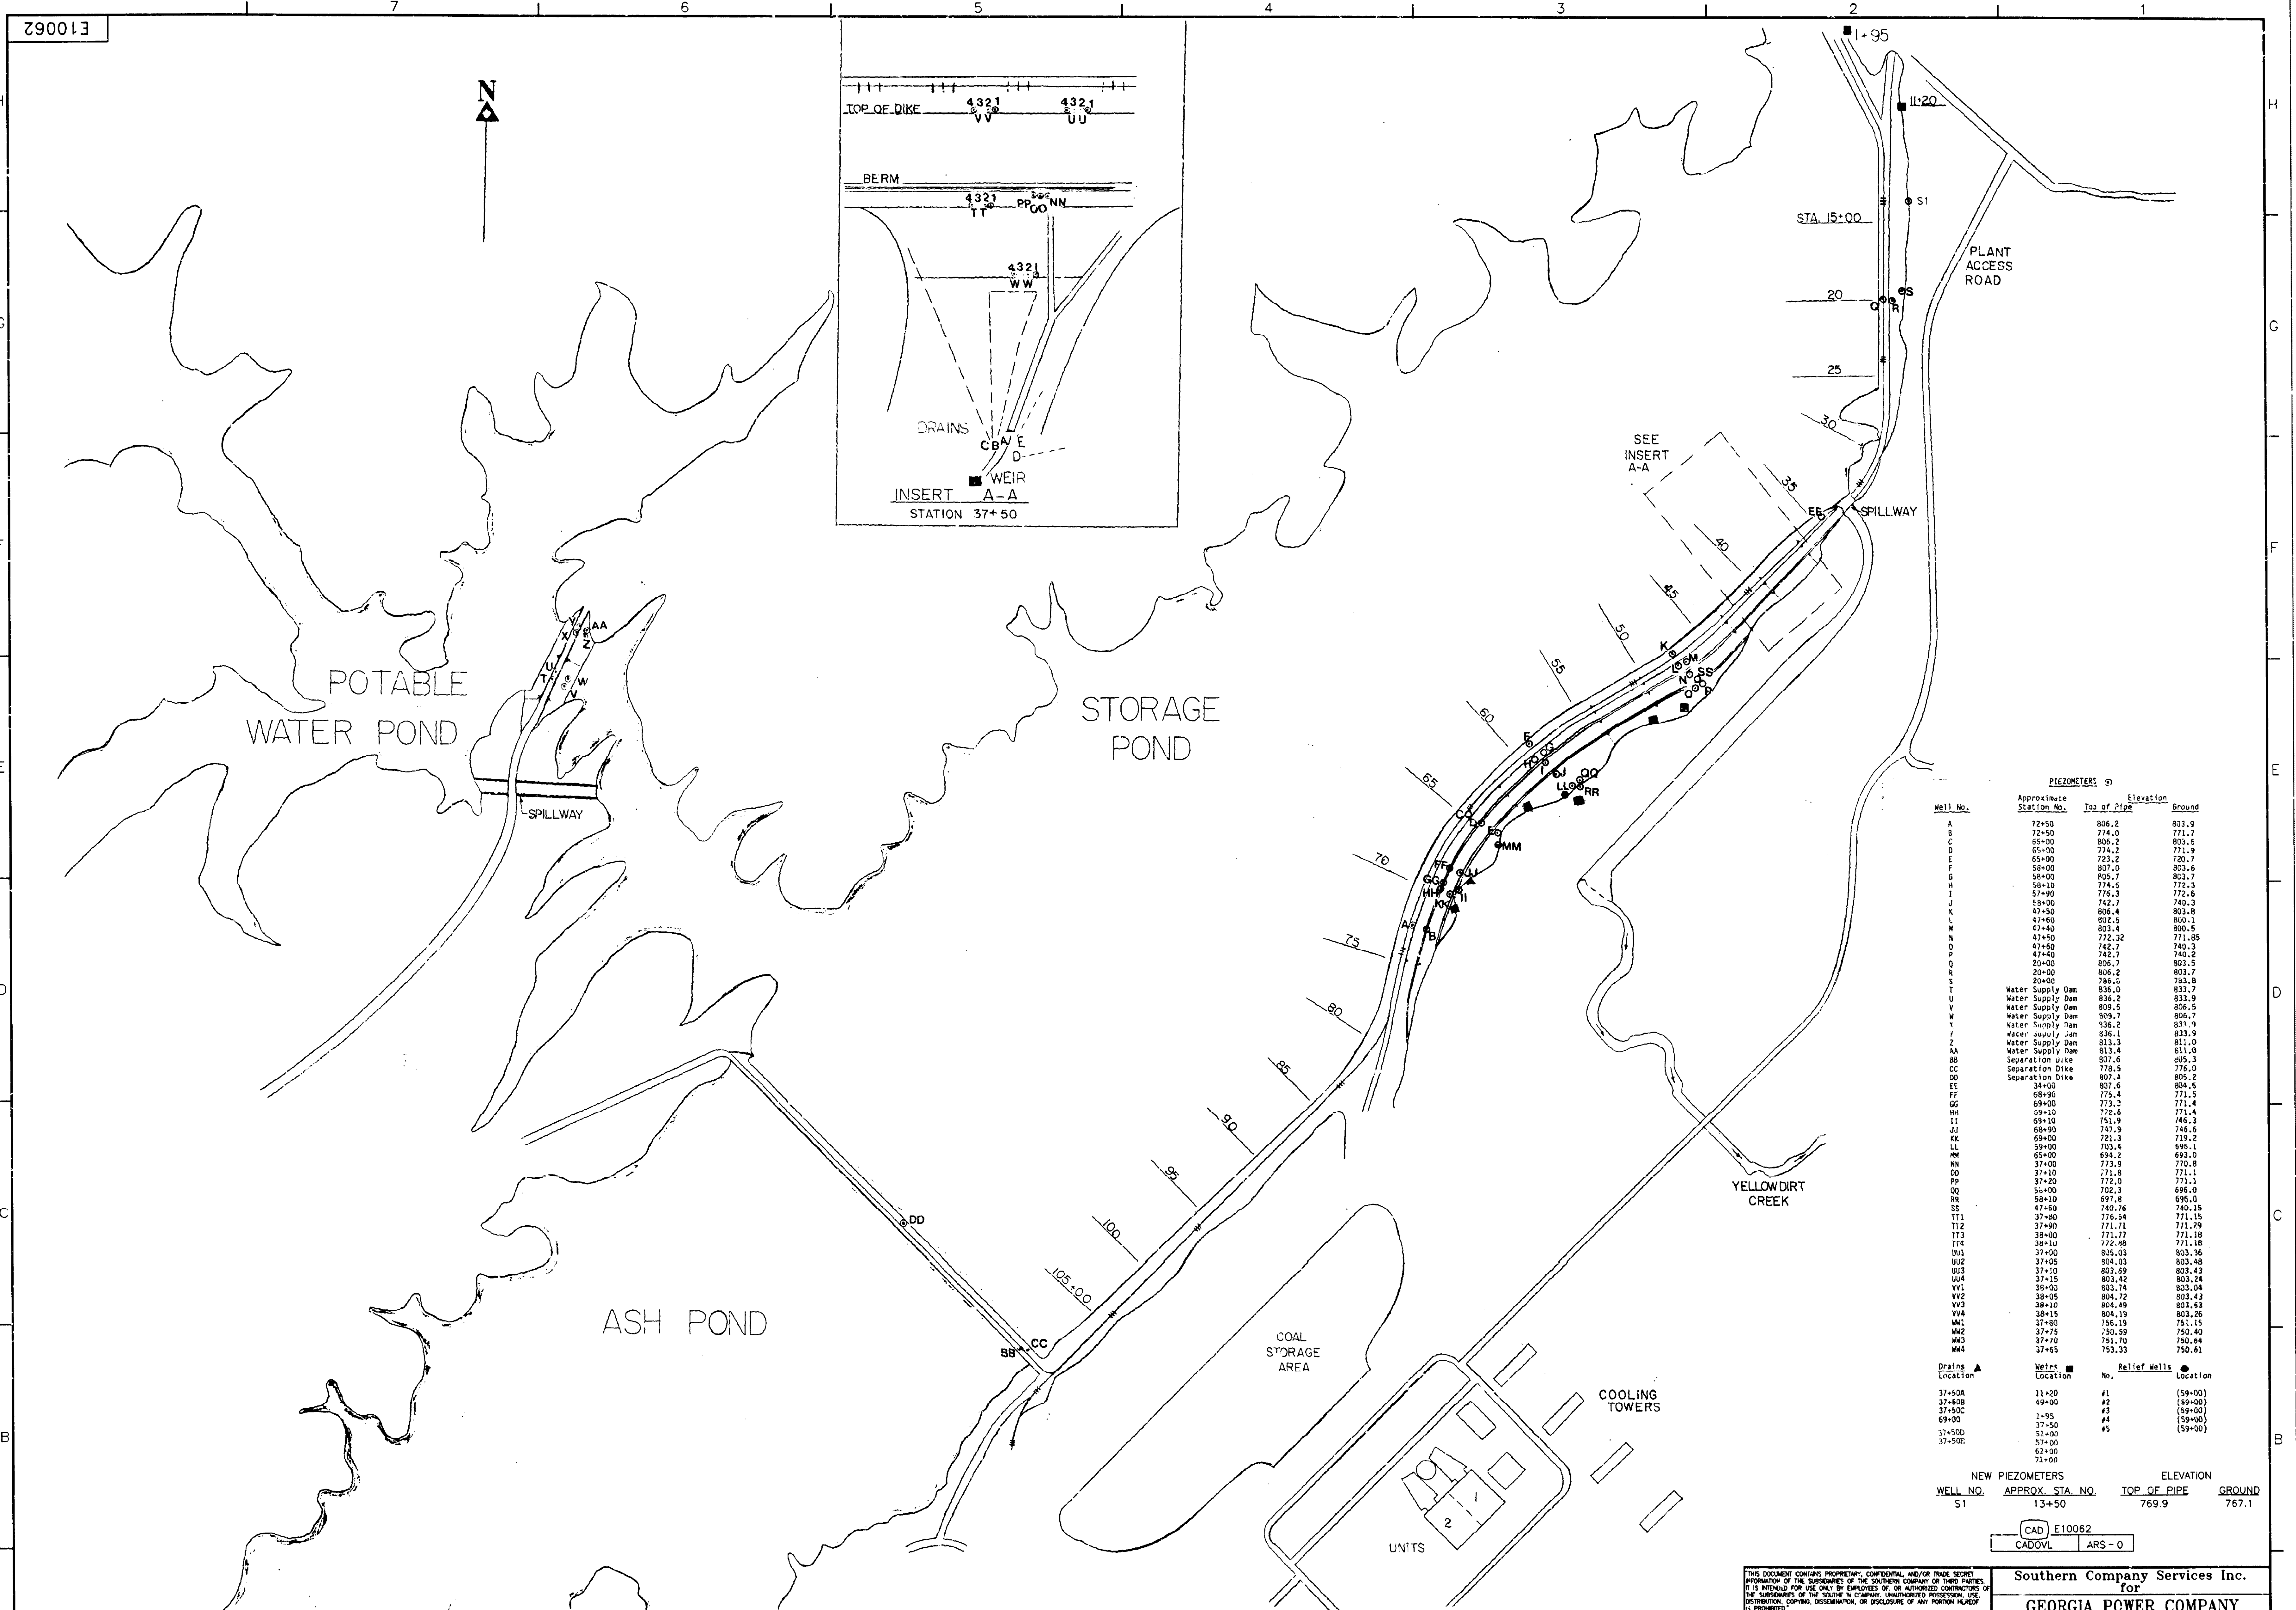

REVISION	DATE	REVISION	DATE	REVISION	DATE	REVISION	DATE	REVISION	DATE	REVISION	DATE	REVISION	DATE	REVISION	DATE	REVISION	DATE	REVISION	DATE
										2	11-5-96	1	1-25-90	0	7-11-88	<b>Southern Company Services Inc.</b> <b>for</b> <b>GEORGIA POWER COMPANY</b> <b>PLANT WANSLEY</b> <b>SURVEILLANCE</b> <b>INSTRUMENTATION</b> <b>LOCATION</b>			
ADD PIEZOMETER S1 REDO SURVEILLANCE LOCATION SYMBOLS. DATE: 8-7-95											ADD ADDITIONAL SURVEILLANCE PER GEORGIA EPD REQUEST				ISSUED FOR PLANT SURVEILLANCE				
JOB NO. WN96900											SCALE LOCATION DRAWING NUMBER REV.								
AWM ASB FOR APPRVL SEE EDRF 9611017											NSF AWM JOP				NONE 10209 E10062 2				